



SDD 10A07 Electrical Details Ground Mount Light Poles Phase-to-Phase Systems

GENERAL NOTES

DETAILS OF CONSTRUCTION AND WORKMANSHIP NOT SHOWN IN THIS DRAWING SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE CONTRACT.

USE THIS DETAIL IN CONJUNCTION WITH THE DETAIL FOR ELECTRICAL HANDHOLE WIRING, SDD10A01.










USE TIME DELAY FUSE PER LUMINAIRE MANUFACTURER RECOMMENDATION.


THE GROUNDING ELECTRODE CONDUCTOR SHALL BE CONTINUOUS WITHOUT SPLICES FROM THE GROUNDING ELECTRODE THROUGH THE HANDHOLD GROUNDING LUG TO THE CONNECTOR.

WIRING FOR SINGLE LUMINAIRE POLES IS SHOWN WITH SOLID LINES. WIRING FOR THE SECOND LUMINAIRE OF TWIN LUMINAIRE POLES IS SHOWN WITH DOTTED LINES.


THE PLANS WILL SHOW WHICH CIRCUIT LEG(S) ARE CONNECTED TO EACH INSTALLATION.

LEGEND

A,B,X,Y,Z	UNGROUNDING CIRCUIT CONDUCTORS
N	GROUNDING CIRCUIT CONDUCTORS
GND	EQUIPMENT GROUNDING CONDUCTOR
P	POLE (ELECTRICAL CIRCUIT)
ϕ	PHASE (ELECTRICAL CURRENT)
	HANDHOLE GROUND LUG
	SINGLE-POLE (1P) FUSE ASSEMBLY
	TWO-POLE (2P) FUSE ASSEMBLY
	UNFUSED LUMINAIRE
	EQUIPMENT GROUNDING ELECTRODE
	TERMINAL
	SPLICE
	CONDUCTOR
	EXOTHERMIC WELD

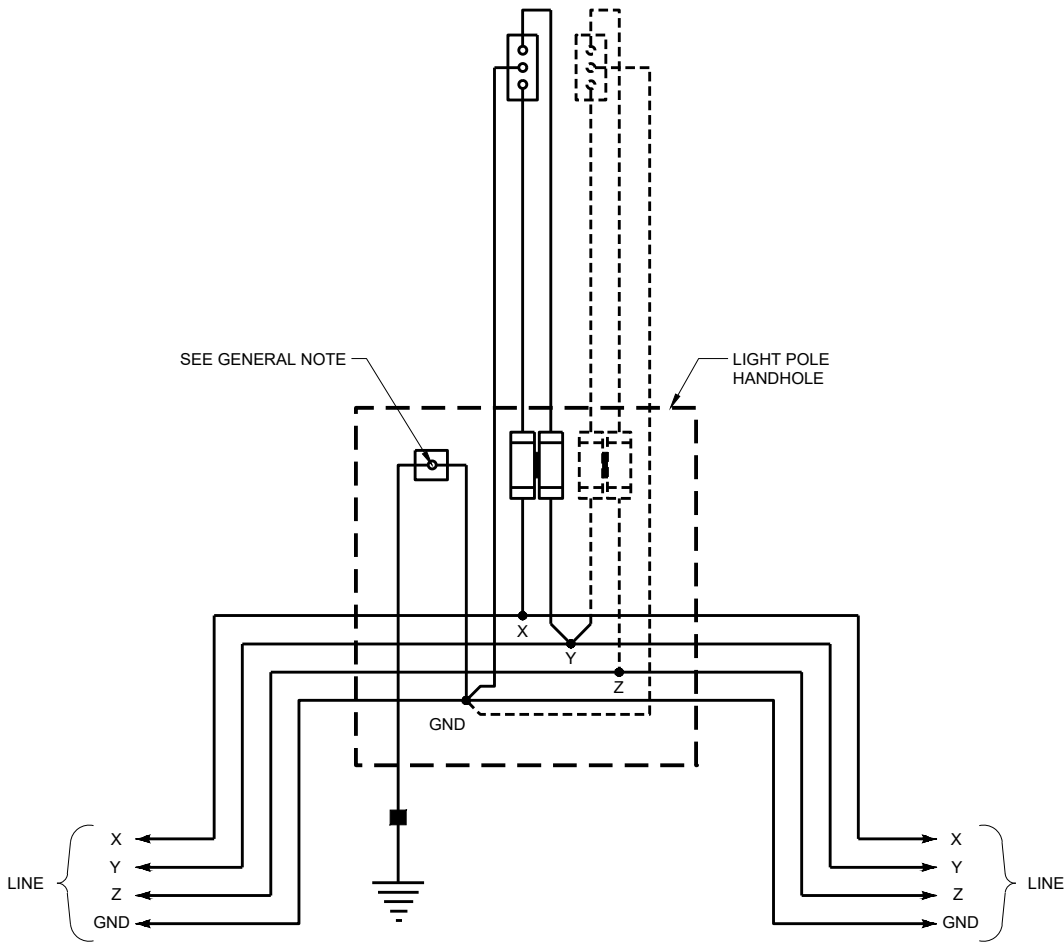

TYPICAL WIRING DIAGRAM
PHASE - TO - PHASE DELTA SYSTEM
3 - ϕ 480VAC 3 WIRE

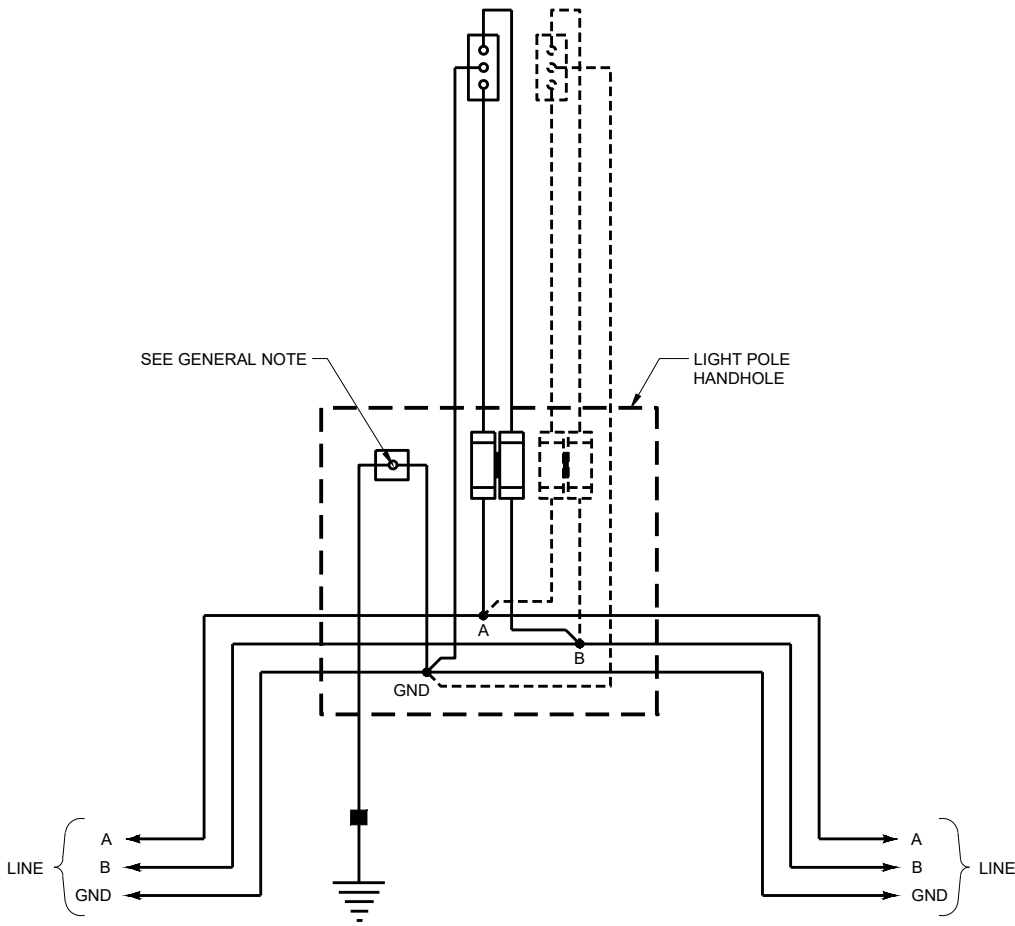

TYPICAL WIRING DIAGRAM
UNGROUNDING SYSTEM
1 - ϕ 120 - 120VAC 2 WIRE

ELECTRICAL DETAILS GROUND MOUNT LIGHT POLES PHASE - TO - PHASE SYSTEMS

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION

APPROVED
November 2018 /S/ Ahmet Demirbilek
DATE STATE ELECTRICAL ENGINEER
FHWA

*Electrical Details Ground Mount Light Poles Phase-to-Phase Systems***References:**

[FDM15-5 Attachment 30.5](#) and [30.6](#) for conventional symbols.
[Standard Spec. 655](#) Electrical Wiring

Bid items associated with this drawing:

<u>ITEM NUMBER</u>	<u>DESCRIPTION</u>	<u>UNIT</u>
655.0600 - 0699	Electrical Wire Lighting (AWG)	EACH

Standardized Special Provisions associated with this drawing:

<u>STSP NUMBER</u>	<u>TITLE</u>
NONE	

Other SDDs associated with this drawing:

[SDD 10A1](#) Electrical Handhole Wiring

Design Notes:

Phase-to-Phase systems are used in some municipalities and for traffic signal intersection lighting in some Districts. The Detail shows double fused luminaries. Use this SDD in conjunction with the SDD for Electrical Handhole Wiring.

Contact Person:

Ahmet Demirbilek (414) 220-6801
(414) 322-9606 (Mobile)